


GENERAL NOTES

1. A CONTINUOUS TRACER WIRE, SUCH AS A SOLID 14-GUAGE COPPER CLAD WIRE WITH BLUE SHIELDING OR APPROVED EQUAL, SHALL BE AFFIXED TO THE TOP OF THE NEW WASTEWATER MAIN PRIOR TO BURY AND SHALL HAVE A SNAKE PIT TRACER STATION INSTALLED AT A MAXIMUM OF 500 FEET.
2. THE TRACER STATION SHALL HAVE A 2' X 2' CONCRETE PAD AROUND IT AND SHALL BE SHOWN ON THE PLANS.
3. TRACER WIRE SHALL BE CONNECTED TO ALL WATER METER ANGLE STOPS, FIRE HYDRANTS, AND VALVE BOX RISERS. WIRE SPLICES SHALL BE COMPLETED USING APPROVED, UNDERGROUND CONNECTORS. SOLDERED CONNECTIONS ARE NOT PERMITTED. A CONTINUITY TEST SHALL BE COMPLETED PRIOR TO ACCEPTANCE.

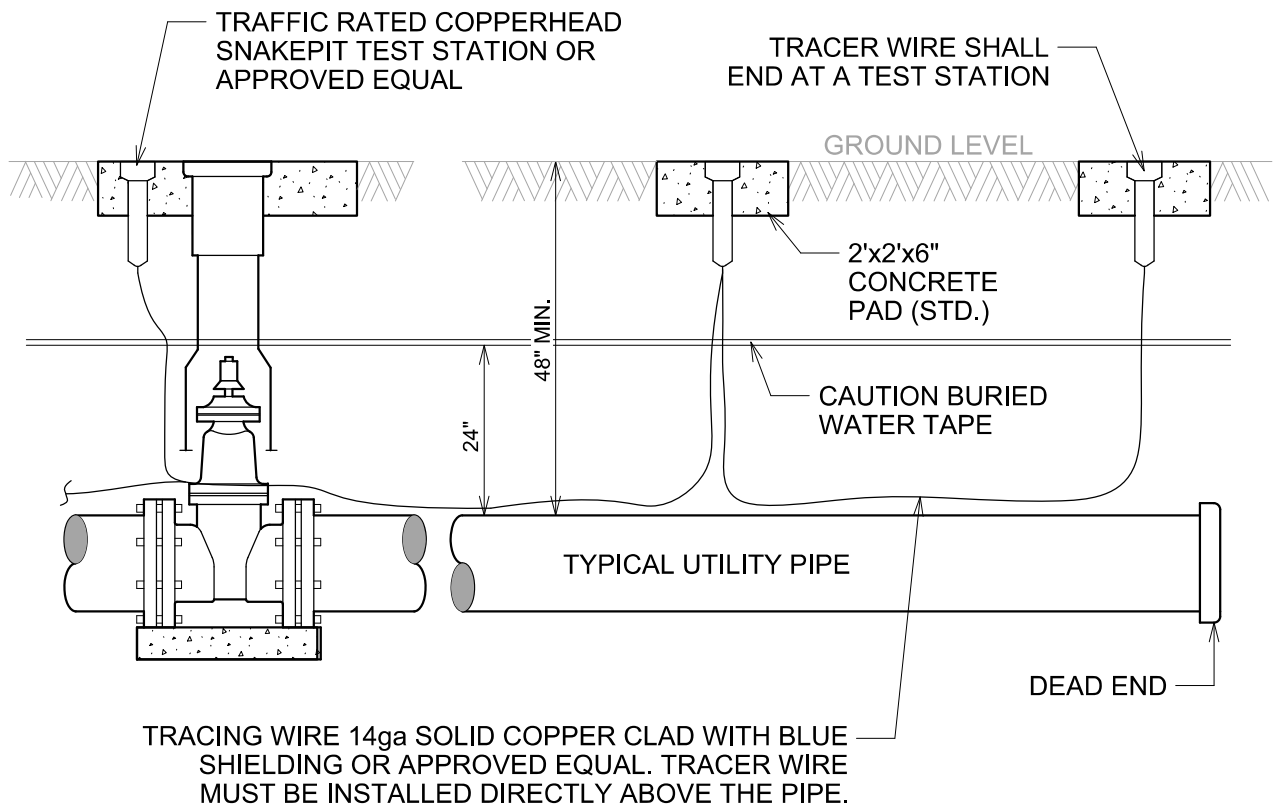

PIPE LOCATION
MARKING
(ALL UTILITIES)

STANDARD CONSTRUCTION DETAILS

DATE: 07/20/21

REVISED
DATE: 07/20/21

BBF - 10