

GENERAL NOTES


1. BEDDING AND INITIAL BACKFILL SHALL BE CEMENT STABILIZED SAND AND SHALL EXTEND FROM 6 INCHES BELOW THE PIPE TO 6 INCHES ABOVE THE PIPE. THE CEMENT STABILIZED SAND BACKFILL SHALL MEET THE FOLLOWING REQUIREMENTS:

A. THE CEMENT SHALL BE PORTLAND CEMENT, TYPE I, ASTM C150.

B. THE SAND SHALL BE CLEAN, DURABLE SAND; LESS THAN 0.5% CLAY CLUMPS, ASTM C142; LESS THAN 0.5% LIGHTWEIGHT PIECES, ASTM C123; ORGANIC IMPURITIES, ASTM C40; NOT SHOWING A COLOR DARKER THAN STANDARD COLOR; AND PLASTICITY INDEX OF LESS THAN 6, ASTM D423 & ASTM D424.

C. CEMENT-SAND MIXTURE SHALL CONSIST OF AT LEAST 1.5 SACKS OF CEMENT PER TON OF SAND. MINIMUM UNCONFINED COMPRESSIVE STRENGTH OF 100 PSI IN 48 HOURS, WHEN COMPACTED TO A MINIMUM OF 95% OF STANDARD PROCTOR DENSITY (ASTM D2922-78 & ASTM D3017-78), WITHOUT ADDITIONAL MOISTURE CONTROL, CURED & TESTED IN ACCORDANCE WITH ASTM C31.

D. CEMENT STABILIZED SAND SHALL BE PLACED & COMPACTED WITHIN 3 HOURS OF BATCHING.

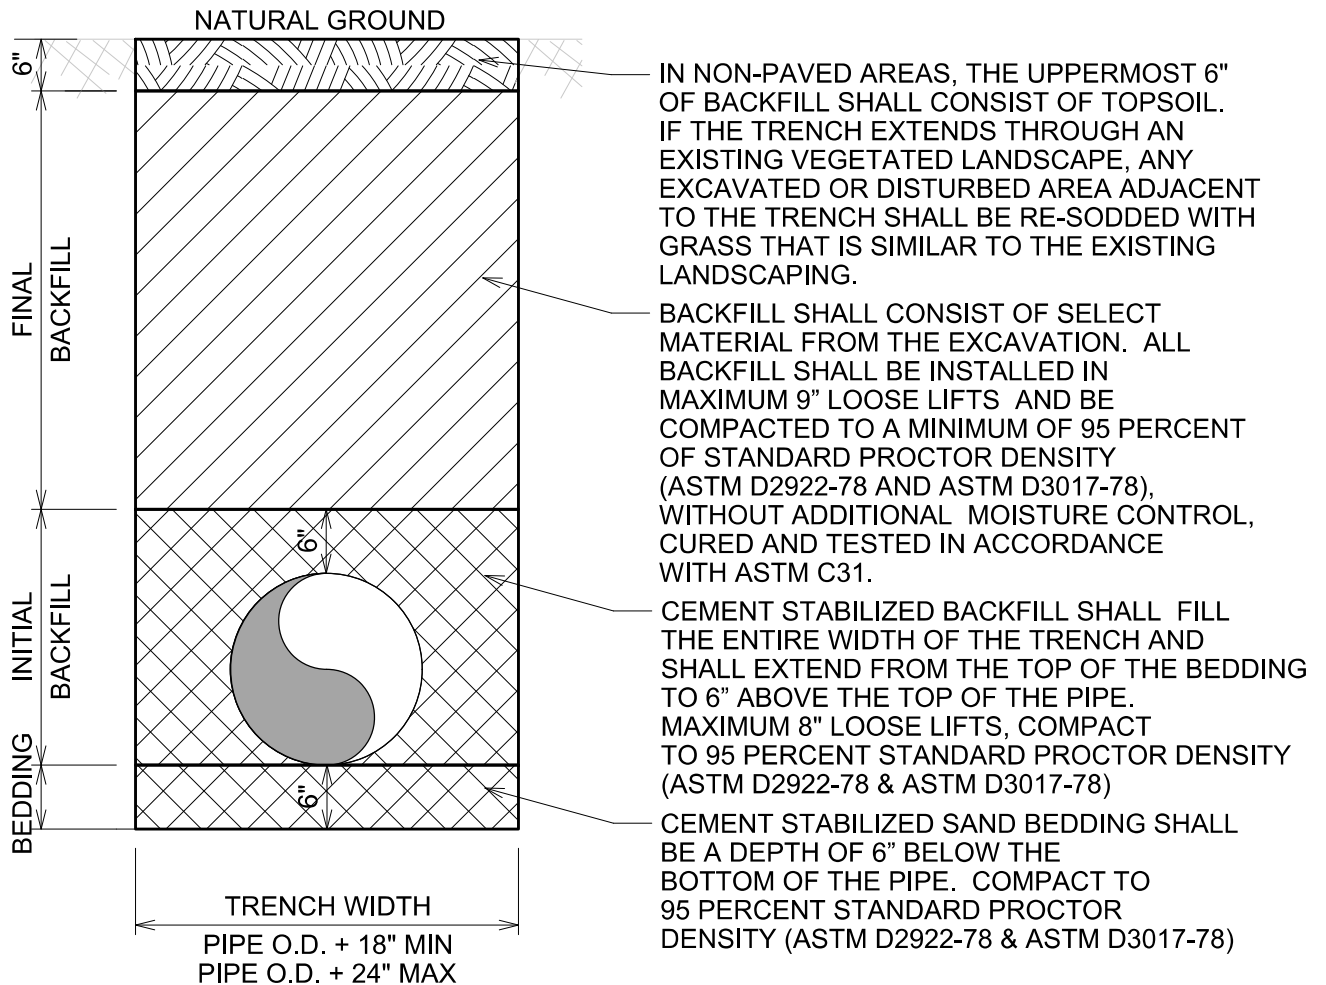

**STORM SEWER
 BEDDING & BACKFILL
 FOR HDPE PIPE
 (NON-PAVED AREAS)**

STANDARD CONSTRUCTION DETAILS

DATE: 07/20/21

REVISED
 DATE: 07/20/21

BBF - 7