


GENERAL NOTES

1. STANDARD DETAIL IS APPLICABLE FOR WATER, SANITARY SEWER AND STORM SEWER.
2. CEMENT STABILIZED SAND SHALL CONTAIN A MINIMUM OF 1.5 SACKS OF CEMENT PER CUBIC YARD. SAND SHALL BE SP, SW OR SM PER USC (ASTM D2487) AND SHALL HAVE THE FOLLOWING PROPERTIES: LESS THAN 15% PASSING #200 SIEVE; LESS THAN 2% CLAY LUMPS; $PI < 7$; $LL < 25$.

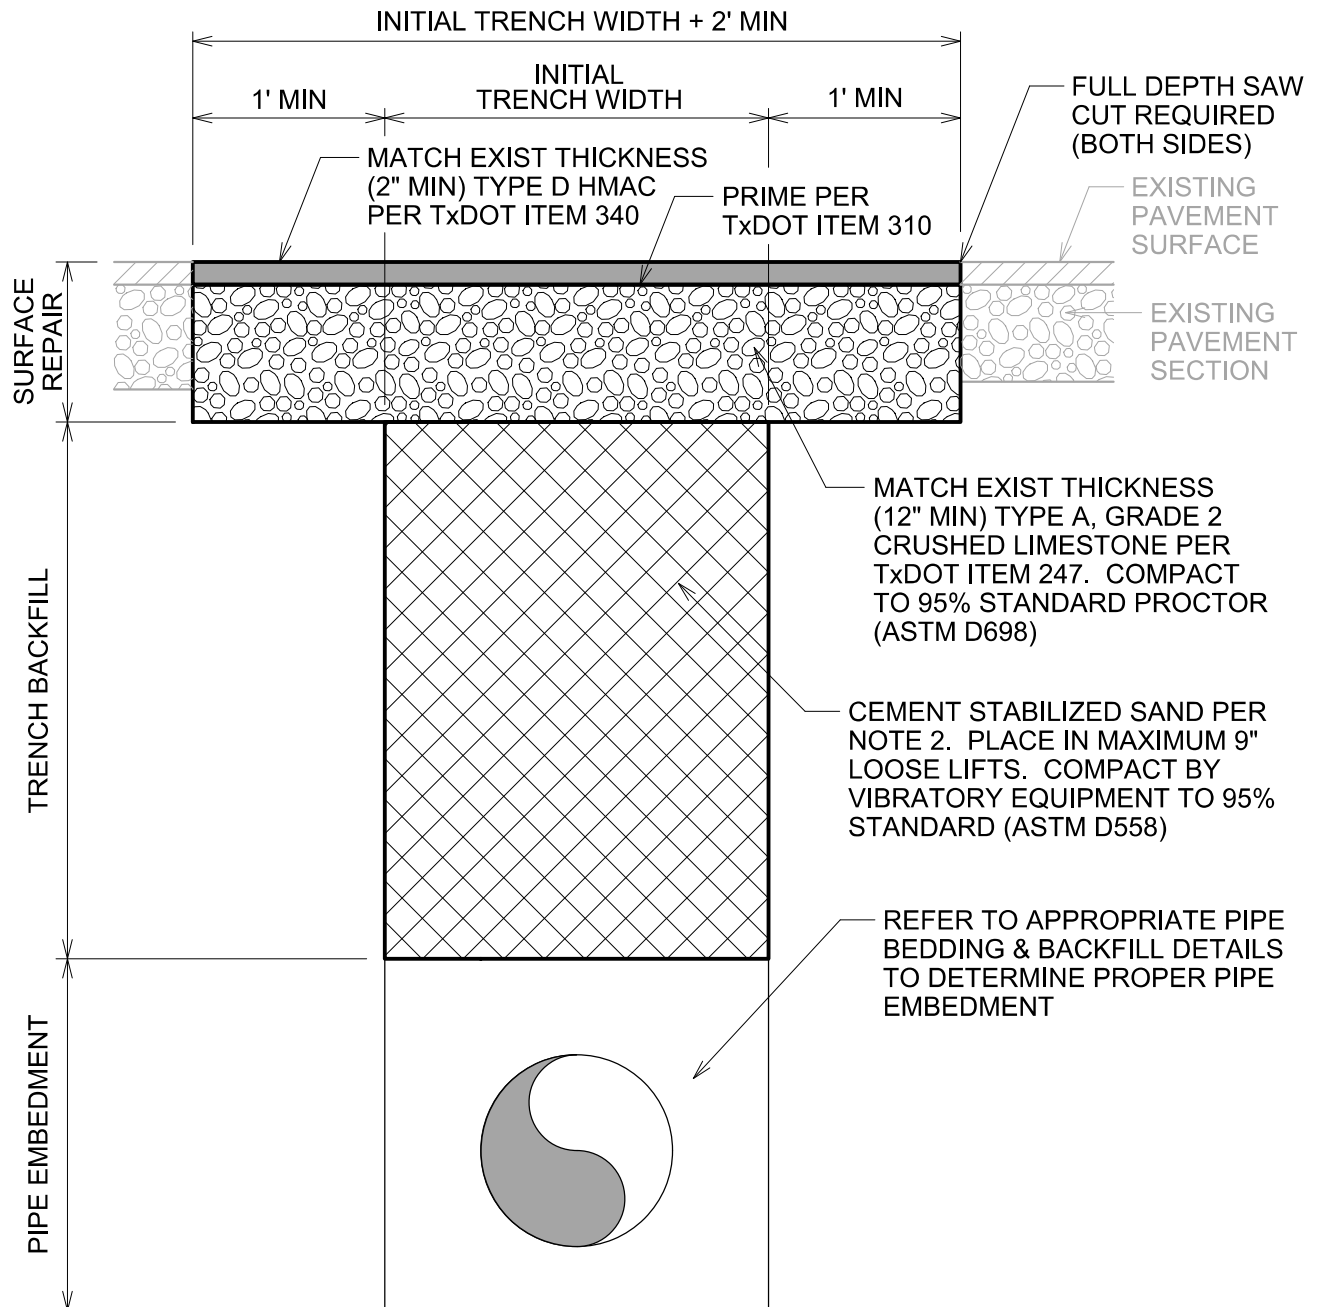

PAVEMENT PATCH FOR EXISTING ASPHALT PAVED AREAS

STANDARD CONSTRUCTION DETAILS

DATE: 10/08/21

REVISED
DATE: 10/08/21

PAV - 16