


## GENERAL NOTES

1. WATER SERVICES 2" AND SMALLER MUST BE SINGLE LOT CONNECTIONS.
2. MINIMUM SIZE SERVICE FOR SINGLE LOT CONNECTION SHALL BE 1".
3. WATER SERVICE SHALL BE LOCATED WITHIN THE RIGHT-OF-WAY AS CLOSE TO THE LOT LINE AS POSSIBLE.
4. CITY OF BRENHAM TO SUPPLY WATER METER UPON PAYMENT OF TAP FEE BY DEVELOPER OR DEVELOPER'S CONTRACTOR.
5. INSTALL TRACER WIRE ALONG SERVICE LINE. CONNECT WITH WATER TIGHT UNDERGROUND CONNECTORS TO THE TRACER WIRE THAT RUNS ALONG THE MAIN WATER LINE. TERMINATE BY LEAVING A 3' SPOOL OF TRACER WIRE INSIDE OF METER BOX.

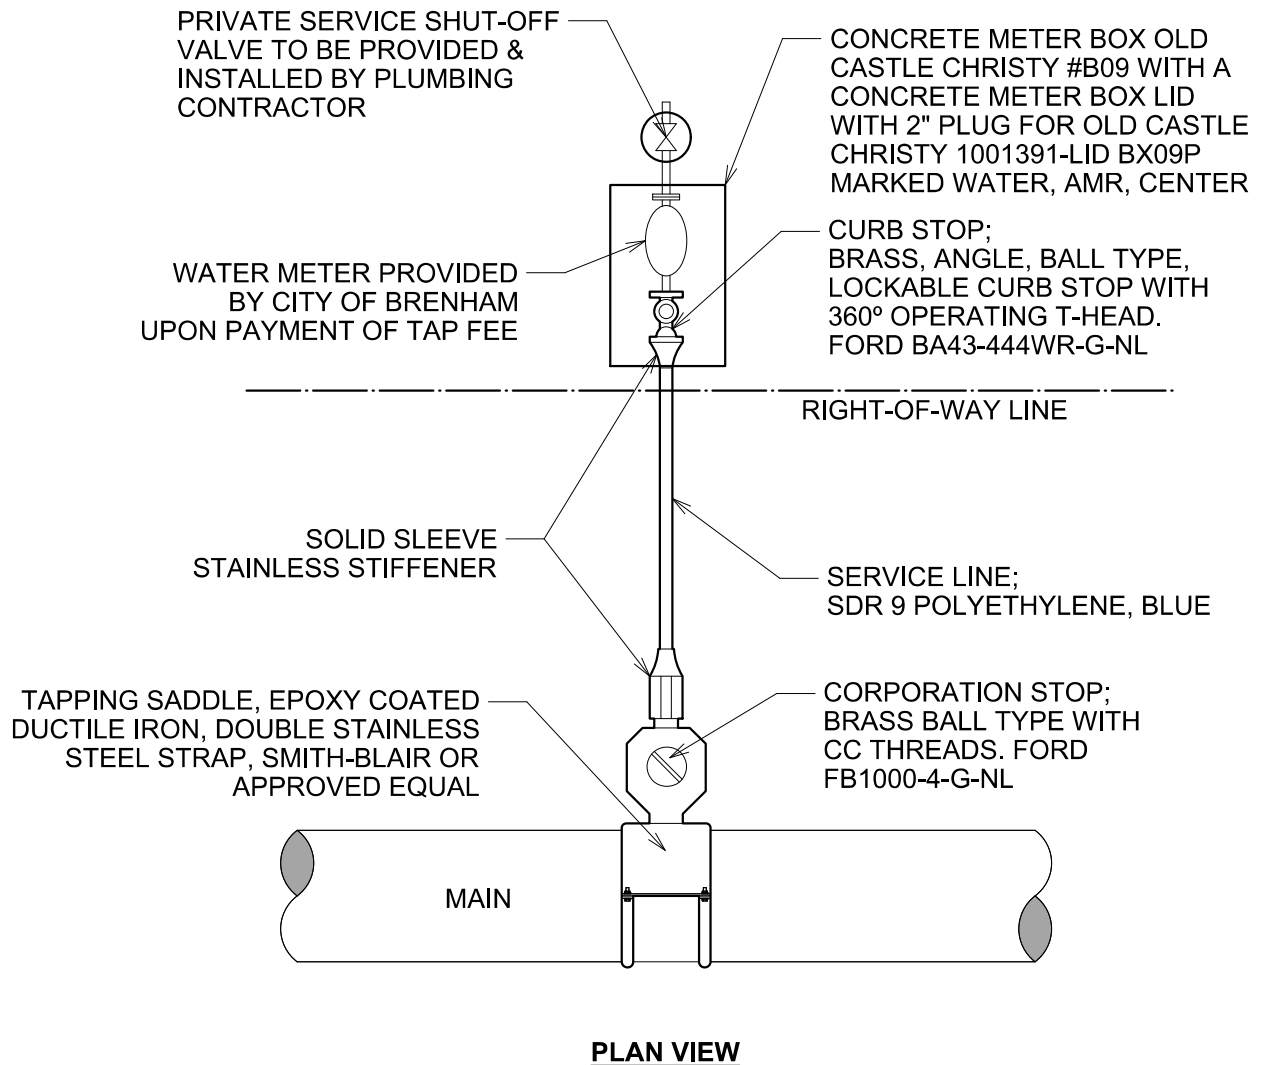

### 1" WATER SERVICE DETAIL (SINGLE SERVICE)

STANDARD CONSTRUCTION DETAILS

DATE: 07/20/21

REVISED  
DATE: 07/20/21

WTR - 11